

WOOD OR STEEL
POSTS AT 6' MIN.
TO 10' MAX. SPACING


MIRAFI INC.
OR ENVIROFENCE
FILTER FABRIC,
OR APPROVED EQUAL

WOVEN WIRE FENCE
(MIN) 14½" GAUGE)
(MAX) 6" MESH SPACING)

COMPACTED BACKFILL

MIN. 6"X6" TRENCH

EXTEND FABRIC INTO TRENCH
A MINIMUM OF 6" VERTICALLY
AND 6" HORIZONTALLY

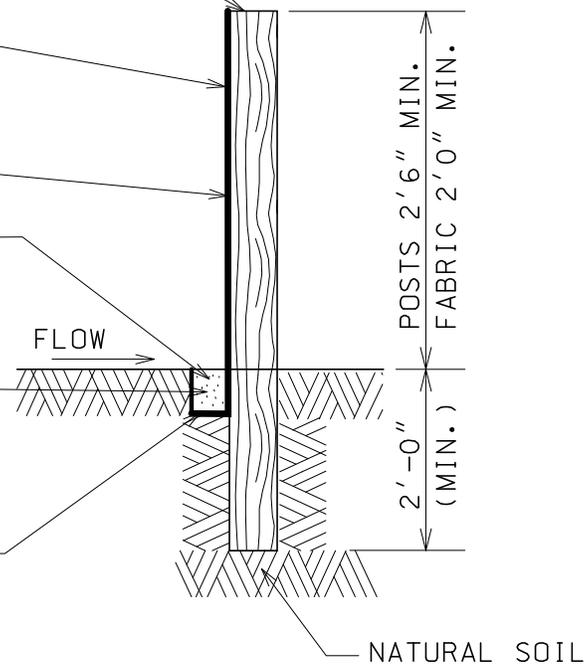

NOTES:

1. FILTER BARRIERS SHALL BE PLACED AT THOSE LOCATIONS SHOWN ON THE PLANS.
2. DEPENDING ON CONFIGURATION, ATTACH FABRIC TO WIRE MESH WITH HOG RINGS, TO WOOD POSTS WITH NAILS, AND TO STEEL POSTS WITH TIE-WIRES AT TOP AND MID-SECTION.
3. OVERLAP FILTER FABRIC BY 6" AND FOLD WHERE 2 SECTIONS

ADJOIN.

4. STRAW BALES MAY BE SUBSTITUTED FOR THE FILTER FABRIC, IF APPROVED BY THE VILLAGE ENGINEERING DEPARTMENT
5. INSPECTION OF SILT FENCES SHALL BE AT LEAST ONCE PER WEEK AND AFTER RAIN EVENTS IN EXCESS OF ½". REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
6. SEDIMENT TRAPPED BY THE FENCE SHALL BE REMOVED AND PROMPTLY DISPOSED OF WHENEVER SIGNIFICANT ACCUMULATION OCCURS.
7. BARRIERS SHALL BE MAINTAINED IN PLACE UNTIL COMPLETION OF CONSTRUCTION AND THE UPSLOPE AREA HAS BEEN STABILIZED, AND BE REMOVED ONLY WHEN DIRECTED BY THE CITY.

NOT TO SCALE

SILT FENCE
DETAIL

DATE: 3-31-09